


**PLAN**

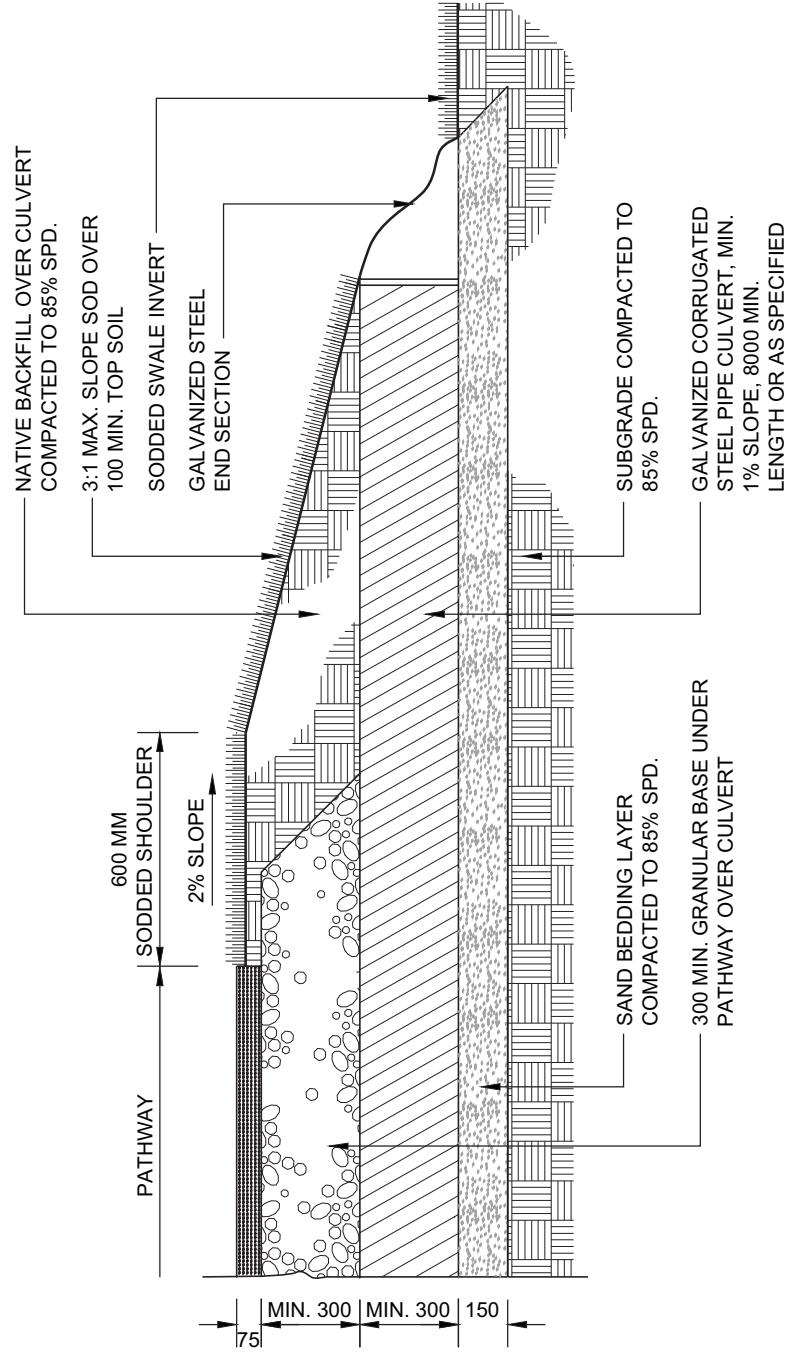

**SECTION**

**NOTES:**

1. CORRUGATED STEEL PIPE CULVERT SHALL BE GALVANIZED, 1.6mm THICK, COMPLETE WITH PREFABRICATED GALVANIZED STEEL END SECTIONS, WITH COLLAR BOLTS, BURIED BELOW GRADE
2. END SECTION COLLAR BOLTS TO BE LOCATED FLUSH OR BELOW GRADE
3. CULVERT TO BE 300 O.D. MINIMUM SIZE, OR AS SPECIFIED
4. INVERT ELEVATIONS OF CULVERTS MUST MATCH ELEVATIONS OF SWALE CENTER
5. ALL MEASUREMENTS ARE IN MILLIMETRES UNLESS STATED OTHERWISE.